

ARTICLE IX
Restrictions, Ground Water Use, Area 1 and 2

§50. Restrictions, Ground Water Use, Area 1 and Area 2.

A. Use of ground water for any purpose in Area 1 as designated on the attached map which was incorporated within a Stipulation and Order of Settlement bearing Civil Action No. 88-CV-934 and filed in the United States District Court on October 4, 1999 is prohibited:


1. The boundary of Area 1 within the Consolidated Water District is depicted on the map attached and incorporated herein.
2. It shall be unlawful for any person to use a well, well water or ground water in Area 1 for any purpose whatsoever.
3. A double check valve assembly (DVCA), or other device approved by the Superintendent, must be properly installed on the owner's side of the meter prior to any connection to the system. This configuration is necessary to prevent any possible transfer of contamination from the owner's plumbing to the system.

Note: All new service connections to the system within Area 1 must have a cross-connection control device installed. All preexisting connections to public water systems within Area 1 must install a cross-connection control device as soon as practicable but not later than 24 months after the effective date of this local law.
4. Any person who violates the water prohibition in Area 1, shall upon conviction thereof, be subject to a fine of up to \$500.00 per violation. Each day for which a violation continues shall be considered a separate violation.

B. Prohibitions on certain uses of ground water in Area 2 as designated on the attached map which was incorporated within a Stipulation and Order of Settlement bearing Civil Action No. 88-CV-934 and filed in the United States District Court on October 4, 1999 are as follows:

1. The boundary of Area 2 within Consolidated Water District is depicted on the map attached and incorporated herein.
2. It shall be unlawful for any person to use a well, well water or ground water in or from Area 2 for drinking, bathing or cooking or for ingestion or human consumption.
3. A double check valve assembly (DVCA), or other device approved by the Superintendent, must be properly installed on the owner's side of the meter prior to any connection to the system. This configuration is necessary to prevent any possible transfer of contamination from the owner's plumbing to the system.
4. Any person who violates the water prohibition in Area 2, shall, upon conviction thereof, be subject to a fine of up to \$500.00 per violation. Each day for which a violation continues shall be considered a separate violation.

FIGURE 1

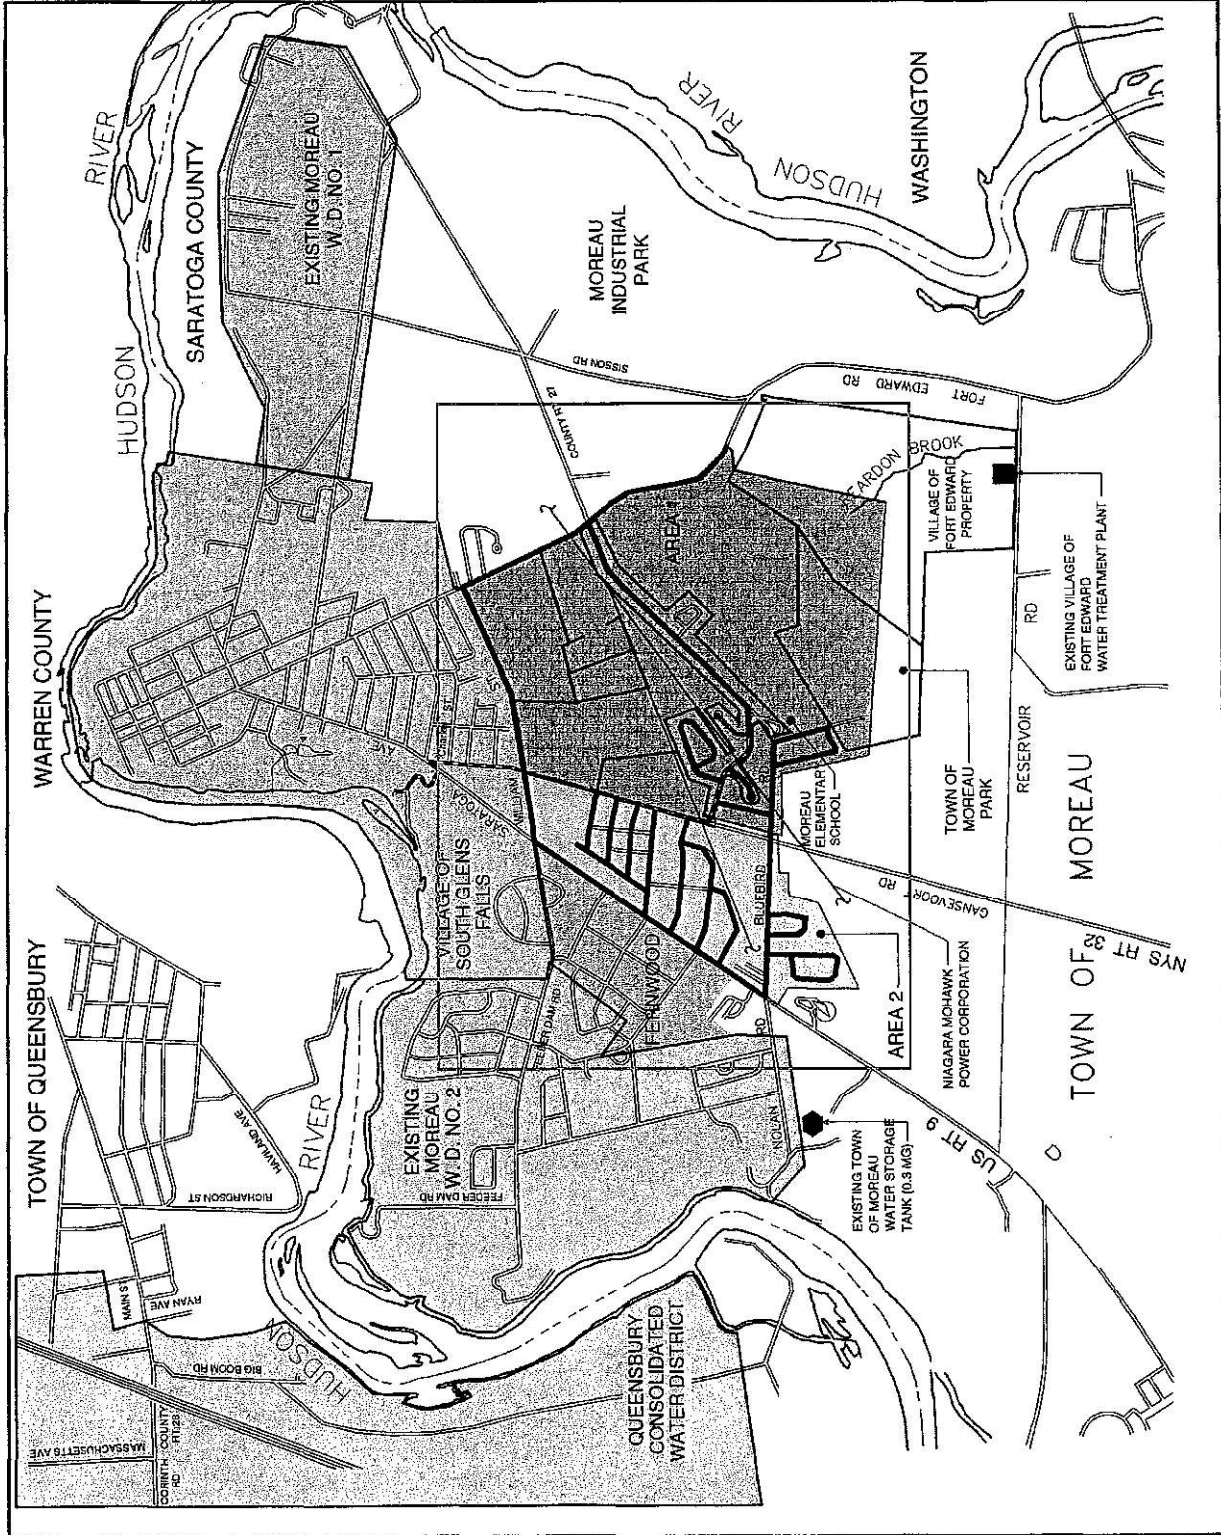

SCALE: 1"=2000'
2000' 1000' 0 2000'

POTENTIAL WATER SERVICE AREAS

Original drawing created by:



BLASLAND & BOCKERT ENGINEERS, P.C.
ENGINEERS & ARCHITECTS

As modified by:



Stearns & Wheeler, LLC
ENVIRONMENTAL ENGINEERS & SCIENTISTS